

Aerobic Granular Sludge–Membrane BioReactor (AGS–MBR)

Subjects: Engineering, Civil

Contributor: Gaetano Di Bella

Membrane-fouling represents a major drawback hampering the wider application of membrane bioreactor (MBR) technology. Fouling can be mitigated by applying aerobic granular sludge technology, a novel kind of biofilm technology characterized by high settleability, strong microbial structure, high resilience to toxic/recalcitrant compounds of industrial wastewater, and the possibility to simultaneously remove organic matter and nutrients. Different schemes can be foreseen for the AGS–MBR process. However, an updated literature review reveals that in the AGS–MBR process, granule breakage represents a critical problem in all configurations, which often causes an increase of pore-blocking.

Keywords: membrane bioreactor ; aerobic granular sludge ; EPS ; fouling ; AGS–MBR

1. Removal Efficiencies of AGS–MBR

Regarding the removal efficiencies of the separated reactors (SBR–MBR) in AGS–MBR, Thanh et al. ^[1] obtained an organic matter removal efficiency higher than 96% in a wide range of OLR (2.5–15 kgCOD/(m³d)). A few years later, the same authors in another experiment ^[2] with a similar reactor configuration obtained a 97.3% dissolved organic matter (DOC) removal efficiency and a 59% total nitrogen (TN) removal efficiency. The latter was achieved through simultaneous nitrification denitrification (SND) in the granular SBR, due to granule redox oxidation-reduction potential (ORP) stratification. Vijayalayan et al. ^[3] obtained 99% of total organic carbon (TOC) removal efficiency, and 61% TN removal efficiency. The latter was mainly limited by e-donor availability. Simultaneous removal of organic matter and nutrients (TN and PO₄-P) in a similar AGS–MBR configuration was reported by Iorhemen et al. ^[4]. The system achieved more than 98% COD removal, 96–99% TN removal, and more than 95% PO₄-P removal. The remarkable removal of nutrients in this AGS–MBR configuration is attributed to the layered structure of aerobic granules, due to oxygen diffusion limitation as well as the proper metabolic selection of PAOs that stratified internally in the granule's layers. When treating industrial wastewater (i.e., citrus wastewater), Di Trapani et al. ^[5] obtained high organic matter removal efficiency close to 95% as COD, similar to the efficiency obtained with traditional MBR.

Concerning the removal efficiencies of the separated configuration with AGS and submerged MBR, Zhou et al. ^[6] reported a 95% COD removal efficiency, and a 90% TN removal efficiency via SND achieved in the granular SBR. High COD removal efficiency (99%) was also obtained by Tay et al. ^[7] for both AGS–MBR and traditional MBR. In a sequencing of AGS–MBR, Tu et al. ^[8] achieved high removal efficiencies in terms of organic matter removal (up to 98%) and nitrogen removal (83–86%).

With reference to the single-reactor AGS–MBR configuration, Li et al. ^[9] and Li et al. ^[10] obtained about 80–95% and 85–90% of COD removal efficiency, respectively. Wang et al. ^[11] reported a TOC removal efficiency in the range 84.7–91.9% and a total nitrogen removal efficiency in the range 41.7–78.4% for a continuous-fed AGS–MBR. Yu et al. ^[12] registered a COD removal efficiency >85%, while Li et al. ^[13] and Juang et al. ^[14] reported a COD removal efficiency >95% and of 91%, respectively. The latter also registered a nitrification efficiency of 96%. Liu et al. ^[15] reported 83%, 67% and 60% for COD, phosphorous, and nitrogen, respectively. High removal efficiencies were also observed by Zhang et al. ^[16], who reported a COD removal efficiency higher than 98% for two AGS–MBRs equipped with different membrane material (i.e., PVDF and PTFE). A nitrification efficiency close to 99% and an TN removal higher than 66% were registered for both the configurations.

Excellent organic matter removal efficiency (i.e., close to 90% for COD) was observed in a continuous-flow AGS–MBR ^[17]. Scarce nutrient (i.e., nitrogen and phosphorus) removal efficiencies were registered after granule breakage, due to the loss of the granule layer. Chen et al. ^[18] obtained high removal efficiency (i.e., >80%) for both organic matter and nitrogen.

Recent studies [19][20] revealed that in a continuous-fed AGS–MBR, it is possible to achieve high organic matter removal efficiency close to 96%, medium nitrogen removal efficiency close to 50%, and medium–low phosphorus removal efficiency close to 35%.

2. Fouling Behavior and Analysis in AGS–MBR Systems: Better or Worse Than Traditional MBR?

As reported in the introduction, fouling is the most important drawback for MBR systems, restraining the filtration efficiency and enhancing operational cost [21]. Fouling is commonly monitored through daily trans-membrane pressure (TMP) registration, the evaluation of the fouling rate (FR) expressed as increase of TMP of the total resistance over time. Furthermore, some studies report a more refined fouling interpretation taking into account the “resistance-in-series (RIS) model” [22][7]. According to this model, the total resistance to filtration (R_t or R_f) can be decomposed into multiple addenda, each referring to the specific fouling mechanism: cake deposition (R_c), which is often divided into reversible ($R_{c,rev}$), and irreversible ($R_{c,irr}$) resistances; and pore-blocking (R_{pb}), an irreversible resistance concerning the occlusion of the internal pores of membrane fibers.

In the following, an updated literature review of the AGS–MBR fouling formation and deposition is reported. In particular, each process configuration is analyzed, and Figure 3 shows a conceptual scheme of fouling mechanisms in AGS–MBR systems.

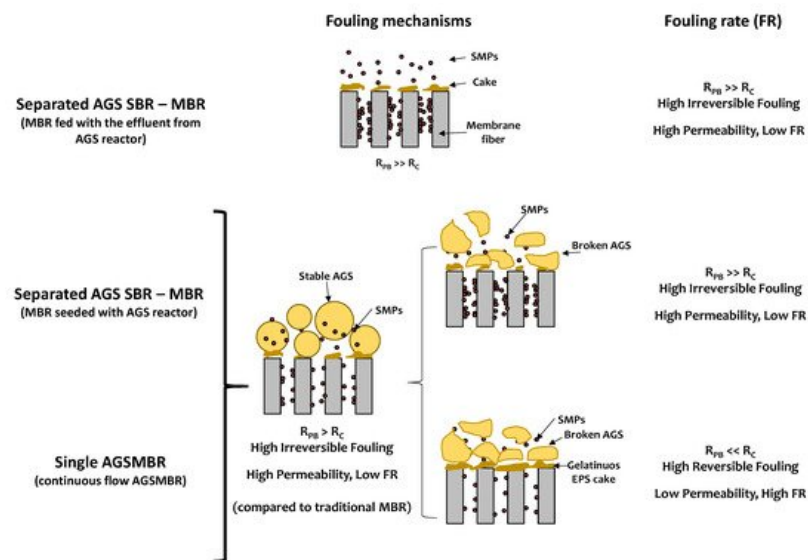


Figure 3. Fouling mechanisms in different AGS–MBR configurations.

2.1. Separated Reactors (SBR–MBR)

Thanh et al. [1] analyzed the fouling behavior of the baffled membrane separation unit treating supernatant of a granulation SBR fed with synthetic wastewater. The OLR of SBR was 10–15 kgCOD/(m³·d) and the MBR unit was equipped with a flat-sheet polyethylene membrane with a pore size of 0.1 μm. Membrane-fouling of AGS–MBR was mainly characterized by pore-blocking, and R_{pb} was close to 59% of R_t . The principal cause of this irreversible fouling was represented by the soluble microbial products (SMPs) of the SBR supernatant, mainly composed of polysaccharides (84% of SMPs), identified as the main foulant that penetrates the membrane porosity. The same authors undertook similar research a few years later [2], with a similar layout: a submerged MBR compartment (polyethylene membrane with a pore size of 0.1 μm) was fed with the supernatant of a granular SBR to perform a treatment with continuity. It was confirmed that the polysaccharidic SMPs were the main causes of irreversible fouling due to pore-blocking. However, they stated that the AGS–MBR configuration showed a lower fouling rate compared to a traditional MBR (0.027 kPa/d), which permitted the extension of the continuous filtration duration (without backwashing) up to 78 days without any physical cleaning techniques. Vijayalayan et al. [3] worked with an MBR (polyethylene membrane with a pore size of 0.1 μm) fed with the effluent of a granular SBR. Also, in this work, the results confirmed that the dominant foulant was represented by polysaccharidic SMPs, which contributed to irreversible fouling. However, a granule breakage was registered due to the very high SRT of granules (300 days) that caused both the excessive growth of filamentous microorganisms and the lack of substrate and nutrient diffusion into the core of granules. This occurrence determined a sudden increase of FR from 0.105 kPa/d (before granule breakage), up to 0.475 kPa/d (after granule breakage). This experimental evidence confirmed the critical issue of AGS stability in AGS–MBR systems that could be preserved by operating within proper SRT values. In another study, Di Trapani et al. [5] studied a separated AGS–MBR process for the treatment of industrial wastewater (i.e.,

citrus wastewater). They observed that the effluent of the granular SBR was characterized by the presence of detached microorganisms and crushed granules, although the reasons for the AGS loss of stability were not addressed. This bulk composition resulted in a more hydrophobic cake layer that rapidly deposited on the membrane surface, thereby resulting in a rapid increase in the R_t in the short-term. Moreover, a similar cake layer was less compressible and more porous, resulting in a lower fouling rate. On the contrary, in such a condition, the mass transport of SMPs (proteins and polysaccharides) within the membrane internal pores will be favored. This circumstance promotes the increase of the irreversible R_{pb} in an AGS–MBR in separated configuration, as reported in previous works [2][1][3].

The configuration with a separated granular sludge SBR feeding an MBR leads to a low FR compared to a traditional MBR, but the fouling is more severe and is mainly irreversible, originated from pore-blocking.

2.2. Separated Reactors (SBR–Submerged MBR with AGS)

Regarding the submerged MBR fed with AGS from granular SBR, Zhou et al. [6] proved that the cake-layer resistance, R_c , in AGS–MBR was lower than the activated sludge MBR. This was likely due to the high back transport of granular sludge that enhanced the deposition of colloids and SMPs onto membrane fibers and into the pores. This led to severe pore-blocking ($R_{pb} = 44\%$), compared to activated sludge MBR. In this case, the cake layer is more compact, less porous, and acts as a biological pre-filter able to biodegrade the organic foulants (i.e., EPS, SMPs) thus preserving membrane integrity. Interesting results were obtained by Tay et al. [23] that showed that AGS–MBR mixed liquor had better filtration properties than activated sludge MBR. Indeed, constant pressure tests indicated that when TMP increased 8-fold, the membrane permeability loss in AGS–MBR was 1.68-fold lower than traditional MBR. Constant flux test showed that when flux increased 3-fold, the loss of membrane permeability in AGS–MBR was 21-fold lower than traditional MBR. Furthermore, during continuous reactor operation, membrane TMP in traditional MBR increased periodically to 50–60 kPa and regular physical cleaning was required. In AGS–MBR, TMPs were at least one order of magnitude (3–6 kPa) lower than traditional MBR and no physical cleaning was required. Moreover, the study remarked that the contribution to fouling due to soluble products was similar in AGS–MBR and MBR. The much better filtration characteristics of AGS–MBR mixed liquor was due to the lower compressibility of its biomass, dominated by aerobic granular sludge. However, the filtration characteristics of the AGS–MBR system can suddenly worsen if the AGS stability is not preserved. Tu et al. [8] tested a submerged sequencing AGS–MBR. In this work, the AGS was cultivated inside the sequencing AGS–MBR, obtaining a complete granulation after 270 days of operation (granule diameter > 300 μm). The increase of membrane-fouling after granulation was low, with a fouling rate close to 0.03 kPa/d (TMP below 8 kPa). The increase of the PN/PS ratio of mixed liquor after granulation caused an increase of hydrophobicity and an improvement of the filterability. Membrane-fouling is closely linked to sludge morphology/structure and AGS was beneficial for slowing down the fouling rate and prolonging the membrane permeability, as stated by Wang et al. [24], who reported an almost steady increase of TMP for AGS–MBR compared to the exponential-like increase in the case of flocculent MBR. In general, pore-blocking was found to be the dominant mechanism in membrane-fouling for AGS–MBR, highlighting that R_{pb} was the key factor and contributed to about 76% of total resistance to filtration. Aerobic granules have a larger size than the pores of the membrane and do not attach to the membrane surface easily. The formed cake layer is characterized by a loose structure that would benefit the overall operation of AGS–MBR resulting in a low fouling rate. However, despite the slow fouling rate, pore-blocking was the main factor for membrane-fouling. This tendency was the opposite compared to a traditional activated sludge MBR, where the compactness of the flocculent cake layer led to a prevalence of cake-fouling ($R_c \approx 61\%$ of R_t). Moreover, with EPS account as the main foulant, its composition in terms of PN/PS was decisive. Indeed, AGS was more hydrophobic than flocculent sludge, which was more hydrophilic. This evidence was confirmed by the different PN/PS ratio of the EPS of both the sludges (PN/PS > 1 for AGS, PN/PS < 1 for flocculent sludge), considering that PN were hydrophobic whereas PS were hydrophilic. Therefore, AGS was intrinsically more hydrophobic than flocculent sludge, and this resulted in a less compact and less compressible cake layer in an AGS–MBR configuration. These results were confirmed by Zhang et al. [16], who reported that the cake layer formed by the AGS was porous, compared to a cake from flocculent activated sludge. This could not prevent small foulants from entering the membrane pores, leading to the blocking of the membrane pores. Furthermore, comparing the PTFE and PVDF membranes, the contents of the EPS and microbial communities on the membranes differed widely depending on different membrane material, and the higher PN contents of the EPS and SMP on the PVDF membrane resulted in more serious fouling. R_{pb}/R_f ratios of the PVDF and PTFE membranes were 59.8% and 56.4%, respectively, which were higher than the corresponding R_c/R_f values. Therefore, the PTFE membrane had better antifouling performance than the PVDF membrane. Furthermore, after physical and chemical cleaning, the PTFE membrane exhibited a higher flux-recovery rate than the PVDF membrane, indicating its superior antifouling performance.

2.3. Single Reactor (AGS–MBR)

The first study taking into account the application of AGS–MBR technology in a continuous-flow feeding mode was conducted by Li et al. [9]. Also, in this configuration, it was reported that the main fouling mechanism was the pore-blocking, due to the lack of a proper cake layer acting as a pre-filter, although the permeability loss was lower than a traditional flocculent MBR. Therefore, the pore-blocking accounts for the main fouling resistance in AGS-membrane filtration. Later, the same research group concluded that the introduction of aerobic granular sludge into MBR could alleviate membrane-fouling and the membrane permeability was 50% higher than that of a membrane bioreactor with floc sludge, despite the increase of internal membrane pore occlusions [25]. One year later, similar results concerning the dominance of pore-blocking fouling in a AGS–MBR were obtained by Juang et al. [14][26]. Li et al. [10] focused on the biogranulation in a continuous-fed AGS–MBR and the relationship with granules stability and membrane-fouling. As reported in the previous sections of the present work, one of the principal factors for a successful and stable granulation is represented by the alternation of feast/famine regime that enhance EPS production and consumption during the starvation. In a continuous-fed AGS–MBR configuration, the mechanisms for EPS production are different and while in a GSBR EPS are cyclically produced and consumed in the feast/famine regime, in a continuously fed AGS–MBR the continuous cut-off of EPS by membranes and the lack of starvation made the EPS concentration increase in sludge and in the supernatant. However, EPSs are known as one of the worst foulants for MBR [24], therefore a proper process management (for instance by regulating the SRT of aerobic granules) should be performed. Wang et al. [11] confirmed that the drastic change of operating mode from SBR to continuous MBR (i.e., the lack of feast/famine regime) can be harmful/fatal for granule stability. Indeed, a partial disaggregation of granular sludge inoculated into a continuous-flow AGS–MBR was observed. This drawback can be determinant in the increase of membrane-fouling and in the loss of nitrogen and suspended solid removal efficiencies. Yu et al. [12] reported a low TMP (<70 kPa) and they attributed this to the lower sludge resistance to filtration (SRF) for granular sludge ($1.5\text{--}4.9 \times 10^{11}$ m/kg), compared to flocculent sludge (4.6×10^{12} m/kg). In another work, Li et al. [13] worked with a mesh filter MBR (nylon and porosity of 70 μm) and highlighted that despite the concept to which EPS are strictly correlated with fouling resistance of MBR [24], in an AGS–MBR the cake porosity or structure can be more important than cake composition. Therefore, the AGS–MBR registered a very low TMP (close to 0.25 kPa) denoting an almost reversible fouling also due to the high porosity of mesh filter (70 μm). An experience with the combination of AGS technology and dynamic MBR (pore size 100 μm) was conducted by Liu et al. [15]. After a hard continuous operation of the dynamic membrane for more than a month, the membrane resistance had no obvious increase, thus demonstrating that membrane-fouling could greatly be reduced by introducing granular sludge in the dynamic MBR. Sajjad et al. [27] studied the hydraulic performance of a continuous-flow membrane bioreactor (CFMBR) where AGS was cultivated. An increase of TMP up to 90 kPa was found after 90 days of continuous filtration. Low fouling rate of 0.25 kPa/d, without any membrane cleaning, was registered. The high PN/PS ratio (3.3) in the GSBR compared to the CFMBR enabled the granular sludge to increase its filtration rates due to the hydrophobic nature of the proteins. However, the relatively higher number of hydrophilic polysaccharides in CFMBR lowered the PN/PS ratio, which subsequently decreased the sludge dewaterability. The granular sludge filterability in AGS–MBR was nearly three times higher than the flocculent sludge of this reactor. The granule formation in this continuous-flow system lessened the concentration of sludge flocs, which resulted in the alleviation of membrane-fouling. The periodic renewal of granules significantly delayed the frequency of membrane cleaning. However, the study did not report the typology of fouling (reversible or irreversible fouling), nor observed any loss of stability in aerobic granules. Iorhemen et al. [28][29] remarked that the major technical problem of AGS–MBR systems is the long-term system operation instability of aerobic granulation and granule disintegration problems. Indeed, the breakage of granules impacts the efficiency of wastewater treatment in the long-term operation, and is a critical issue in full-scale operations. Granule disintegration increases the concentration of soluble EPS, consequently increasing the irreversible membrane-fouling (i.e., pore-blocking). Corsino et al. [17] proposed a continuous-flow reactor with a novel geometric configuration, aiming at clarifying the mechanisms linked to the stability of AGS in a continuous-fed AGS–MBR in terms of structural characteristics and biological performance. A particular layout was designed to achieve the feast/famine regime physically in the space in the continuous-flow reactor, given that in an SBR the feast/famine regime occurs along the SBR cycle time. This work opened a new possible scenario in AGS–MBR technology, since it was reported that the pore-blocking resistance (Rpb) was about one order of magnitude lower than the irreversible cake that was removable with proper physical cleaning [22], so no chemical cleaning was necessary. This was an important novelty, compared to previous studies of AGS–MBR [28], where pore-blocking fouling was dominant. However, in this experiment, a huge loss of granule stability was observed. The granule breakage determined an irreversible fouling resistance, mainly represented by a compact and hydrophobic cake, composed of gelatinous EPS from broken AGS. A smaller fraction of SMP produced by substrate use was responsible for a residual pore-blocking of membrane fibers. The principal reason for the failure of granule stability is attributable to high granule SRT (i.e., about 50 days) in a continuous-flow AGS–MBR [17]. Indeed, by operating at high SRT, the growth of filamentous microorganisms inside the granule structure is possible [30]. This occurrence could cause the breakage of AGS, and

operating at lower SRT could enhance the maintenance of AGS structure [17]. Chen et al. [18], did not observe severe fouling in their continuous-flow AGS-MBR with granules cultivated inside the system. Iorhemen et al. [19][20] observed that in a continuous-fed AGS-MBR it is possible to obtain a gentle TMP rise due to the sloughing of the cake layer through the abrasion by AGS. Moreover, they observed that the rise in TMP (up to 46 kPa) is due to the high protein content in soluble EPS. However, TMP was low, despite the registered high PN/PS ratio. Zhang et al. [31] discussed a novel issue for membrane-fouling in AGS-MBR systems linked to the granule sizes, finding that there is a critical size (1–1.2 mm mean diameter) with the highest membrane-fouling. Below that, the cake-fouling layer is tight and high compressibility emerged, while some pore-blocking occurs. Above that, this cake-fouling layer becomes loose and highly permeable, and more EPSs emerge. Working in this critical size, membrane-fouling is the most serious, because of the dual role of the compact structure of cake-fouling layer and the adhesion of EPS. The “antifouling” ability of AGS can be effectively maximized by avoiding or keeping away from the critical size. In a recent work, Song et al. [32] confirmed that granular sludge exhibited significantly lower fouling (i.e., lower fouling rate) potential than conventional activated sludge in AGS-MBR also under high salinity environment. The bigger size of granular sludge induced higher shear transport, which overwhelmed the filtration dragging force and foulant-membrane interaction, consequently leading to less deposition on the membrane surface. The most recent work dealing with AGS-MBR was conducted by Zhang et al. [33], focusing on the effect of scouring on fouling mitigation. A new hydrodynamic model was developed to explain the scouring mechanism of AGS. The scouring stress, proportional to the total amount of AGS depositing on the membrane surface, effectively reinforced the collision between AGS and membrane and reduced their deposition on the membrane surface by friction with the membrane. Thus, it was further conducive to membrane-fouling mitigation. Moreover, a novel contribution quantification model was proposed for analyzing the contribution rate of AGS scouring effect to mitigate membrane-fouling. AGS scouring possessed a significant contribution rate (39.9%) for fouling mitigation, compared with AGS structure (50.3%) and hydraulic stress (9.7%). In conclusion, this study provides an in-depth understanding to mitigate MBR membrane-fouling by the unique advantages of sludge granulation.

In summary, when the AGS encounters the membrane unit and granules preserve their structural stability, both in separated SBR-MBR reactors and in a single AGS-MBR reactor, the cake layer is more porous and swollen, leading to a higher permeability (low FR) and a higher irreversible fouling (i.e., pore-blocking) compared to the traditional MBR (Figure 3). If AGS loses its structural stability, the two main cases of fouling behavior can be identified: (i) a severe irreversible fouling due to pore-blocking, but a low FR; and (ii) a high reversible fouling, due to cake-layer deposition of gelatinous EPS of broken AGS, which leads to a high FR.

3. Future and Perspective of AGS-MBR Technology

AGS-MBR technology offers great potential for fouling mitigation and wastewater treatment in traditional MBR processes [28]. The main advantage was provided by AGS towards membrane cake deposition, thus acting as a “fouling retardant”. Indeed, the continuous rubbing of aerobic granules with membrane fibers involved a sensible lowering of fouling rate as TMP increases versus time [33]. Many studies [28][27][31] refer to a contextual worsening of irreversible fouling (i.e., pore-blocking) due to the high presence of SMPs in the bulk that penetrates inside the porosity of membranes, both for the separated configuration (two reactors SBR-MBR) and the combined configuration (single-reactor AGS-MBR). This was due to the higher SMP production in an AGS system than an activated sludge system, and to the occurrence of granule instability problems that led to the disintegration of granules in the long term [28]. However, from the literature review [33][17][18][31], it is possible to point out four main possibilities to develop stable AGS-MBR systems in the future, preventing the growth of irreversible pore-blocking in the membrane filtration unit: (i) cultivate AGS directly in the new AGS-MBR configuration; (ii) ensure the occurrence of anaerobic-feast/aerobic-famine regime in the continuous-flow reactors; (iii) control granule mean dimensions such that they are far from critical values (1–1.2 mm); and (iv) manage AGS scouring.

Cultivating AGS directly in the new AGS-MBR system has the advantage of physically and metabolically selecting the granules according to the new operational conditions [18], thus obtaining stable and durable aggregates. When AGS is seeded to the AGS-MBR from a separated cultivation SBR, the granules underwent a drastic variation of environmental and operational conditions that hampered the maintenance of structural stability during time. If AGS is formed inside the AGS-MBR configuration, the durability of granules is more probable. Furthermore, as almost all the single-reactor AGS-MBR configurations are fed in continuous-flow mode, a crucial operational condition to promote/preserve granule stability is the occurrence of anaerobic-feast/aerobic-famine regime [17]. This circumstance is fundamental both in the cultivation phase of granules, to select slow-growing organisms (i.e., PAOs and GAOs) that will enhance the formation of AGS, and in the operation phase to outcompete the fast-growing flocculent organisms (i.e., ordinary heterotrophic organisms, OHOs) thus ensuring the maintenance of granule structural stability. Proper management of granule size, far from the critical mean diameter of 1–1.2 mm in an AGS-MBR, is considered an important factor to mitigate membrane-fouling [31]. In particular, the irreversible fouling caused by pore-blocking is inversely proportional to granules sizes. Therefore, to

minimize pore-blocking, having AGS sizes above the critical range is beneficial. Furthermore, the overall stability of an AGS–MBR system can be guaranteed by keeping a proper scouring effect of AGS towards membrane fibers [33], thus ensuring a fouling control and extending the durability of membrane. Finally, by comparing the AGS–MBR process to a traditional activated sludge MBR, it is possible to assert that the main advantage of AGS–MBR configuration is related to the possibility to operate with higher flux than an activated sludge MBR without observing a worsening of the permeability or fouling rate of the membrane. However, the management of an AGS–MBR process is more critical than traditional MBR due to the maintenance of structural stability of AGS and the mitigation of fouling through specific operational conditions (e.g., work far from the critical size of AGS; apply a proper scouring to membrane fibers), to avoid a severe irreversible fouling from pore-blocking in the long term.

References

1. Thanh, B.X.; Visvanathan, C.; Sprandio, M.; Aim, R. Ben Fouling characterization in aerobic granulation coupled baffled membrane separation unit. *J. Memb. Sci.* 2008, 318, 334–339.
2. Thanh, B.X.; Visvanathan, C.; Ben Aim, R. Fouling characterization and nitrogen removal in a batch granulation membrane bioreactor. *Int. Biodeterior. Biodegrad.* 2013, 85, 491–498.
3. Vijayalayan, P.; Thanh, B.X.; Visvanathan, C. Simultaneous nitrification denitrification in a Batch Granulation Membrane Airlift Bioreactor. *Int. Biodeterior. Biodegrad.* 2014, 95, 139–143.
4. Iorhemen, O.T.; Hamza, R.A.; Zaghloul, M.S.; Tay, J.H. Simultaneous organics and nutrients removal in side-stream aerobic granular sludge membrane bioreactor (AGMBR). *J. Water Process Eng.* 2018, 21, 127–132.
5. Di Trapani, D.; Corsino, S.F.; Torregrossa, M.; Viviani, G. Treatment of high strength industrial wastewater with membrane bioreactors for water reuse: Effect of pre-treatment with aerobic granular sludge on system performance and fouling tendency. *J. Water Process Eng.* 2019, 31, 100859.
6. Zhou, J.; Yang, F.-L.; Meng, F.-G.; An, P.; Wang, D. Comparison of membrane fouling during short-term filtration of aerobic granular sludge and activated sludge. *J. Environ. Sci.* 2007, 19, 1281–1286.
7. Di Bella, G.; Di Trapani, D. A brief review on the resistance-in-series model in membrane bioreactors (MBRs). *Membranes* 2019, 9, 24.
8. Tu, X.; Zhang, S.; Xu, L.; Zhang, M.; Zhu, J. Performance and fouling characteristics in a membrane sequence batch reactor (MSBR) system coupled with aerobic granular sludge. *Desalination* 2010, 261, 191–196.
9. Li, X.; Gao, F.; Hua, Z.; Du, G.; Chen, J. Treatment of synthetic wastewater by a novel MBR with granular sludge developed for controlling membrane fouling. *Sep. Purif. Technol.* 2005, 46, 19–25.
10. Li, X.F.; Li, Y.J.; Liu, H.; Hua, Z.Z.; Du, G.C.; Chen, J. Correlation between extracellular polymeric substances and aerobic biogranulation in membrane bioreactor. *Sep. Purif. Technol.* 2008, 59, 26–33.
11. Wang, J.; Wang, X.; Zhao, Z.; Li, J. Organics and nitrogen removal and sludge stability in aerobic granular sludge membrane bioreactor. *Appl. Microbiol. Biotechnol.* 2008, 79, 679–685.
12. Yu, G.-H.; Juang, Y.-C.; Lee, D.-J.; He, P.-J.; Shao, L.-M. Filterability and extracellular polymeric substances of aerobic granules for AGMBR process. *J. Taiwan Inst. Chem. Eng.* 2009, 40, 479–483.
13. Li, W.W.; Wang, Y.K.; Sheng, G.P.; Gui, Y.X.; Yu, L.; Xie, T.Q.; Yu, H.Q. Integration of aerobic granular sludge and mesh filter membrane bioreactor for cost-effective wastewater treatment. *Bioresour. Technol.* 2012, 122, 22–26.
14. Juang, Y.C.; Su, A.; Fang, L.H.; Lee, D.J.; Lai, J.Y. Fouling with aerobic granule membrane bioreactor. *Water Sci. Technol.* 2011, 64, 1870–1875.
15. Liu, H.; Li, Y.; Yang, C.; Pu, W.; He, L.; Bo, F. Stable aerobic granules in continuous-flow bioreactor with self-forming dynamic membrane. *Bioresour. Technol.* 2012, 121, 111–118.
16. Zhang, B.; Huang, D.; Shen, Y.; Yin, W.; Gao, X.; Shi, W. Treatment of municipal wastewater with aerobic granular sludge membrane bioreactor (AGMBR): Performance and membrane fouling. *J. Clean. Prod.* 2020, 273, 123124.
17. Corsino, S.F.; Campo, R.; Di Bella, G.; Torregrossa, M.; Viviani, G. Study of aerobic granular sludge stability in a continuous-flow membrane bioreactor. *Bioresour. Technol.* 2016, 200, 1055–1059.
18. Chen, C.; Bin, L.; Tang, B.; Huang, S.; Fu, F.; Chen, Q.; Wu, L.; Wu, C. Cultivating granular sludge directly in a continuous-flow membrane bioreactor with internal circulation. *Chem. Eng. J.* 2017, 309, 108–117.
19. Iorhemen, O.T.; Hamza, R.A.; Sheng, Z.; Tay, J.H. Submerged aerobic granular sludge membrane bioreactor (AGMBR): Organics and nutrients (nitrogen and phosphorus) removal. *Bioresour. Technol. Rep.* 2019, 6, 260–267.

20. Iorhemen, O.T.; Hamza, R.A.; Zaghloul, M.S.; Tay, J.H. Aerobic granular sludge membrane bioreactor (AGMBR): Extracellular polymeric substances (EPS) analysis. *Water Res.* 2019, 156, 305–314.
21. Meng, F.; Chae, S.-R.; Drews, A.; Kraume, M.; Shin, H.-S.; Yang, F. Recent advances in membrane bioreactors (MBRs): Membrane fouling and membrane material. *Water Res.* 2009, 43, 1489–1512.
22. Campo, R.; Capodici, M.; Di Bella, G.; Torregrossa, M. The role of EPS in the foaming and fouling for a MBR operated in intermittent aeration conditions. *Biochem. Eng. J.* 2017, 118, 41–52.
23. Tay, J.H.; Yang, P.; Zhuang, W.Q.; Tay, S.T.L.; Pan, Z.H. Reactor performance and membrane filtration in aerobic granular sludge membrane bioreactor. *J. Memb. Sci.* 2007, 304, 24–32.
24. Wang, Y.; Zhong, C.; Huang, D.; Wang, Y.; Zhu, J. The membrane fouling characteristics of MBRs with different aerobic granular sludges at high flux. *Bioresour. Technol.* 2013, 136, 488–495.
25. Li, X.; Li, Y.; Liu, H.; Hua, Z.; Du, G.; Chen, J. Characteristics of aerobic biogranules from membrane bioreactor system. *J. Memb. Sci.* 2007, 287, 294–299.
26. Juang, Y.C.; Lee, D.J.; Lai, J.Y. Fouling layer on hollow-fibre membrane in aerobic granule membrane bioreactor. *J. Chin. Inst. Chem. Eng.* 2008, 39, 657–661.
27. Sajjad, M.; Kim, I.S.; Kim, K.S. Development of a novel process to mitigate membrane fouling in a continuous sludge system by seeding aerobic granules at pilot plant. *J. Memb. Sci.* 2016, 497, 90–98.
28. Iorhemen, O.T.; Hamza, R.A.; Tay, J.H. Membrane fouling control in membrane bioreactors (MBRs) using granular materials. *Bioresour. Technol.* 2017, 240, 9–24.
29. Iorhemen, O.T.; Hamza, R.A.; Tay, J.H. Membrane bioreactor (Mbr) technology for wastewater treatment and reclamation: Membrane fouling. *Membranes* 2016, 6, 33.
30. Morales, N.; Figueroa, M.; Mosquera-Corral, A.; Campos, J.L.; Méndez, R. Aerobic granular-type biomass development in a continuous stirred tank reactor. *Sep. Purif. Technol.* 2012, 89, 199–205.
31. Zhang, W.; Jiang, F. Membrane fouling in aerobic granular sludge (AGS)-membrane bioreactor (MBR): Effect of AGS size. *Water Res.* 2019, 157, 445–453.
32. Song, W.; Xu, D.; Bi, X.; Ng, H.Y.; Shi, X. Intertidal wetland sediment as a novel inoculation source for developing aerobic granular sludge in membrane bioreactor treating high-salinity antibiotic manufacturing wastewater. *Bioresour. Technol.* 2020, 314, 123715.
33. Zhang, W.; Liang, W.; Zhang, Z.; Hao, T. Aerobic granular sludge (AGS) scouring to mitigate membrane fouling: Performance, hydrodynamic mechanism and contribution quantification model. *Water Res.* 2021, 188.